

Sample Received: July 14, 2026

PRODUCT INFORMATION

|                             |                                     |                                          |                             |                             |
|-----------------------------|-------------------------------------|------------------------------------------|-----------------------------|-----------------------------|
| Vendor:<br>Biolabs Research | Sample Name:<br>Selank + Semax 10mg | Sample Type:<br>White lyophilized powder | Lot Number:<br>07022026-042 | MW (g/mol):<br>751.9, 813.9 |
|-----------------------------|-------------------------------------|------------------------------------------|-----------------------------|-----------------------------|


ANALYTICAL METHODS

Identity: Confirmed via LC-MS  
Purity: RP-HPLC (214 nm)  
Content: HPLC quantitation

TEST RESULTS

| Specification            | Result        | Method            | Status     |
|--------------------------|---------------|-------------------|------------|
| Identity: Selank + Semax | Selank, Semax | LC-MS/MS          | ✓ Conforms |
| Content                  | 5.71, 5.33 mg | HPLC Quantitation | ✓ Conforms |
| Overall Purity           | 99.80%        | RP-HPLC (214 nm)  | ✓ Conforms |
| Endotoxin                | <0.05 EU/mL   | <USP85>           | ✓ Conforms |

HPLC Chromatogram (Retention Time: 2.313 9.385 min)

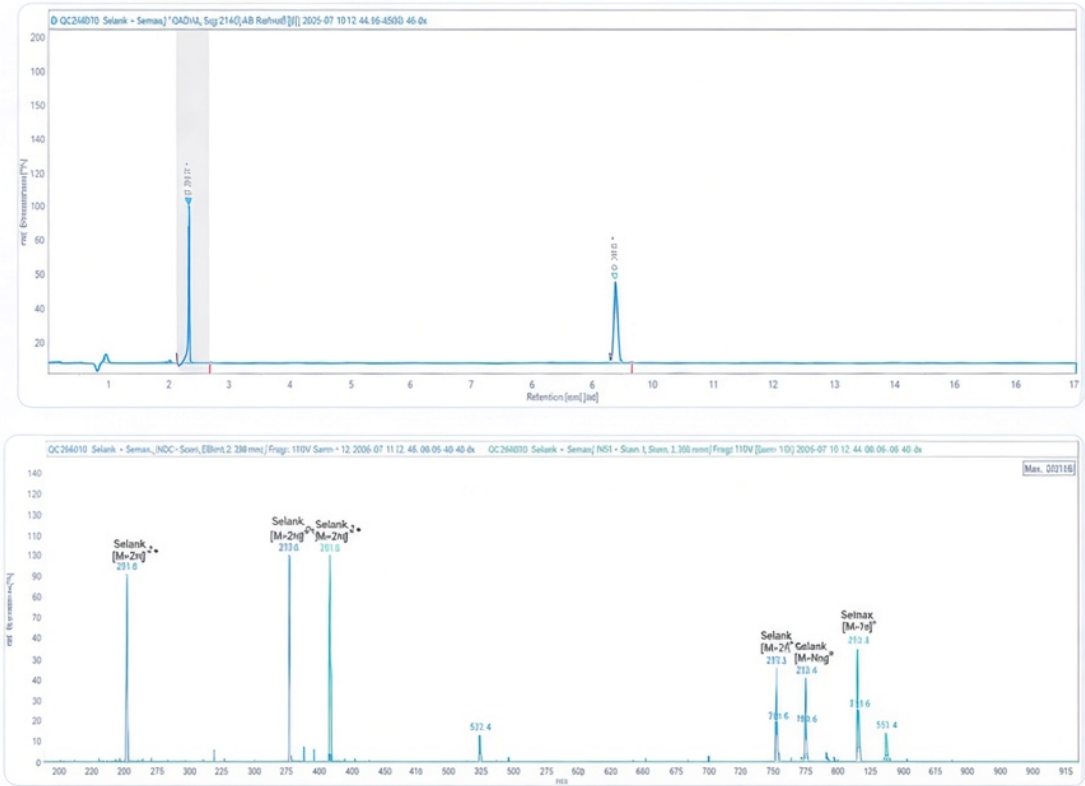

Certification: This COA confirms that the tested material meets or exceeds Bioviridian's analytical quality specifications for peptide research use.  
Visit: <https://bioviridians.com/coa-search.html>

Shane Straight  
Shane Straight, M.S.  
Principal Chemist, Bioviridian Inc.